



ACFoam® HD CoverBoards



ATLAS ROOFING CORPORATION

ENVIRONMENTAL PRODUCT DECLARATION

ISO 14025:2006 and ISO 21930:2017



**Certified
Environmental
Product Declaration**
www.nsf.org

Atlas Roofing Corporation is pleased to present this Environmental Product Declaration (EPD) for ACFoam® HD CoverBoards. This EPD was developed in compliance with ISO 14025 and ISO 21930 and has been verified by NSF.

The LCA and the EPD were prepared by Vertima Inc. The EPD includes cradle-to-gate with options life cycle assessment (LCA) results.

For more information about Atlas Roofing Corporation, visit www.atlasrwi.com.

For any explanatory material regarding this EPD, please contact the program operator.

1. GENERAL INFORMATION

PCR GENERAL INFORMATION			
Reference PCR	PCR Part B: Roof Cover Protection Board EPD Requirements (UL 10010-36), v.1.0 and its core PCR Part A: Life Cycle Assessment Calculation Rules and Report Requirements (UL 10010-36), v.4.0 UL Environment November 2021 to November 2026 (validity period of PCR Part B) March 28, 2022 to March 28, 2027 (validity period of PCR Part A)		
The PCR review was conducted by:	<i>Jack Geibig (Chair)</i> Ecoform, LLC jgeibig@ecoform.com	<i>Angela Fisher, LCA CP</i> Aspire Sustainability angela@aspireustainability.com	<i>Mike Ennis</i> Ennis Associates m.ennis@mac.com
EPD GENERAL INFORMATION			
Program Operator	NSF 789 N. Dixboro Road, Ann Arbor, Michigan 48105 USA www.nsf.org		
General Program Instructions	NSF International, NSF Certification Policies for Environmental Product Declarations (EPD), 2022		
Declared Products	ACFoam® HD CoverBoard ACFoam® HD CoverBoard FR		
EPD Registration Number EPD 11326	EPD Date of Issue July 28, 2026	EPD Period of Validity July 28, 2026 to July 28, 2031	
EPD Recipient Organization	Atlas Roofing Corporation 2100 Riveredge Parkway, Suite 600 Atlanta, GA 30328 www.atlasrwi.com		
EPD Type/Scope and Functional Unit			Year of Reported Manufacturer Primary Data
Product-specific cradle-to-gate with options EPD with functional unit of 1 m² of installed roof cover board, including 7% installation waste.			2023
Geographical Scope North America	LCA Software OpenLCA v.2.03	LCI Databases Ecoinvent 3.9.1	LCIA Methodology TRACI 2.2, IPCC AR5, CML 4.8
This LCA and EPD were prepared by:		Vertima Inc. www.vertima.ca	
This EPD and LCA were independently verified in accordance with ISO 14025:2006, ISO 14040:2006, ISO 14044:2006 and ISO 21930:2107, as well as the UL Environment PCR "Part B: Roof Cover Protection Board EPD Requirements (UL 10010-36), v.1.0," and PCR "Part A: Life Cycle Assessment Calculation Rules and Report Requirements (UL 10010), v.4.0," which serves as the core PCR.			
☐ Internal ☒ External		Joseph Geibig Ecoform, LLC	

The owner of the declaration shall be liable for the underlying information and evidence; NSF or its affiliates, shall not be liable with respect to manufacturer information, life cycle assessment data, and evidence.



LIMITATIONS

Environmental declarations within the same product category but from different programs may not be comparable.
[1]

Comparison of the environmental performance of products using EPD information shall be based on the product's use and impacts at the building level, and therefore EPDs may not be used for comparability purposes when not considering the building energy use phase as instructed under this PCR. Full conformance with the PCR for roof cover protection boards allows EPD comparability only when all stages of a life cycle have been considered, when they comply with all referenced standards, use the same sub-category Part B PCR, and use equivalent scenarios with respect to construction works. However, variations and deviations are possible (e.g. Different LCA software and background LCI datasets that may lead to differences in calculated and reported results upstream or downstream of the life cycle stages declared).[2], [3]

The results of this study are representative of Atlas Roofing Corporation's 2023 production data on ACFoam® HD CoverBoards with coated glass facer.

2. PRODUCT SYSTEM DESCRIPTION

Atlas Roofing Corporation, hereinafter Atlas, has more than 40 years of experience manufacturing polyiso. The company has grown from a single manufacturing facility into an industry leader with 8 polyiso plants in North America and worldwide product distribution.

2.1. PRODUCT DESCRIPTION

Atlas ACFoam® HD CoverBoard and ACFoam® HD CoverBoard FR (hereinafter ACFoam® HD CoverBoards), both high-density options offering compressive strengths from 80 to 110 psi, are cellular closed-cell rigid foam plastic insulation. Polyiso roof¹ cover boards consist of a foam core between two facers (top and bottom). The foam core is comprised of a thermoset polymer that hardens by curing from a viscous liquid prepolymer. The rigid foam is produced through the reaction of methylene diphenyl diisocyanate (MDI) with polyester polyol. Other additives such as catalyst, surfactant, flame retardant, and blowing agent (pentane or pentane blends) are part of the formulation. Pentane is a hydrocarbon with negligible ozone depletion potential (ODP) [7] and low global warming potential (GWP).[8] For nearly 30 years, the polyiso industry has only utilized pentane or pentane blends in product formulations. Upon mixing of the components, the viscous pre-polymer is laid between the facers, and a chemical reaction cross-links polymer chains, creating a rigid, durable, and closed-cell structure.



Figure 1: ACFoam® - HD CoverBoard.

¹ CSI and CSA MasterFormat® Reference: 07 22 16 Roof board insulation.



2.2. PRODUCT APPLICATION

ACFoam® HD CoverBoards may be used in commercial, light commercial, residential, and industrial roof construction projects on new buildings and on existing buildings during reroofing, and provide added rigidity, strength and impact resistance. These products are versatile and compatible with single-ply roof membrane systems (i.e., TPO, PVC and EPDM) and modified bitumen (self-adhered and cold-applied) roof membrane systems. The ACFoam® HD CoverBoards are also compatible with various insulation types. These products are installed in roof systems between the insulation (below) and roof membrane (above) and may be mechanically attached or adhered. A typical roof system that includes ACFoam® HD CoverBoards is illustrated in Figure 2. Many factors and design considerations impact the selection of a roof system, and additional components, such as an air barrier, vapor retarder, and thermal barrier, may be required in specific applications.

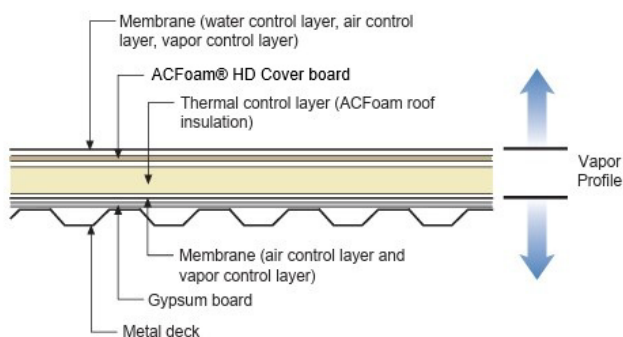


Figure 2: Typical roof assembly with polyiso ACFoam® HD CoverBoard installed between the insulation and the roof membrane.

2.3. MATERIAL COMPOSITION

ACFoam® HD CoverBoards are comprised of a foam core and two facers on the top and bottom surfaces. The foam core consists of the average weighted formulation by mass listed in Table 1. More than half of the foam formulation consists of MDI which reacts with polyester polyol containing other chemicals including blowing agent, flame retardant, surfactant, catalyst, and water. The product contains no other additives, nor ancillary materials known to remain in the product. The chemical reaction forms a rigid cellular foam structure following a curing process. The most common type of facer for ACFoam® HD CoverBoards is CGF.

Table 1: Weighted average ACFoam® HD CoverBoards material composition and foam formulation.

Component		Formulation (% by mass)
		Facer: CGF
		80 psi / 550 kPa
Facer		52.8%
Foam		47.6%
Foam composition	MDI	61.8%
	Polyester Polyol	29.8%
	Blowing Agent (Pentane)	2.4%
	Flame Retardant (TCPP)	3.9%
	Surfactant	0.5%
	Catalyst	1.4%
	Water	0.1%



2.4. TECHNICAL DATA

ACFoam® HD CoverBoards are manufactured to meet the requirements of industry consensus product specifications and standards in the United States and Canada. Note: Compliance with model building codes does not always ensure compliance with state or local building codes, which may be amended versions of these model codes. Always check with local building code officials to confirm compliance. Typical physical properties for ACFoam® HD CoverBoards are listed in Table 2.

- ASTM C1289 – Standard Specification for Faced Rigid Cellular Polyisocyanurate Thermal Insulation.
- CAN/ULC-704.1 – Standard for Thermal Insulation, Polyurethane and Polyisocyanurate, Boards, Faced.

Table 2: Typical physical properties of ACFoam® HD CoverBoards and corresponding requirements listed in ASTM C1289 and CAN/ULC-704.1 standards.

Physical Property	Standard Designation	ASTM C1289 (Type II, Class 4) 2.5 ft ² °F h/Btu)	CAN/ULC-704.1 (Type 4, 5 and 6) 0.44 m ² K/W
Thermal Resistance per 12.7 mm (0.5-inch) – RSI (R-Value)		Thermal resistance determined per ASTM C518 at 75°F mean temperature using materials conditioned in accordance with ASTM C1289	
Compressive Strength, Min	ASTM D1621	80 psi	550 kPa
Flexural Strength, Min	ASTM C203	400 psi For 12.7 mm (0.5 inch) product	2750 kPa
Tensile Strength, Min		2000 psf determined per ASTM C209	95 kPa determined per ASTM D1623
Dimensional Stability, % Linear Change, Length and Width, Max	ASTM D2126	< 0.5%	< 0.5%
Water Absorption, % by Volume, Max		4.0 determined per ASTM C1763 – Procedure B	3.5 determined per ASTM D2842 – Procedure B
Water Vapor Permeance at 1 inch	ASTM E96/E96M Dessicant Method	<1.5 perm	< 85.8 ng/Pa·s·m ²)

Thermal Performance: The use of continuous insulation is required in model building codes as a prescriptive measure of increasing energy efficiency of building envelope components, including exterior roofing. The thermal resistance (R-value) or long-term thermal resistance (LTTR) is a measure of insulation's resistance to heat transfer for a given material thickness. The R-value of polyiso insulation board is determined on full thickness boards using a test method described in ASTM C518 "Standard Test Method for Steady-State Thermal Transmission Properties by Means of the Heat Flow Meter Apparatus." LTTR is determined using test methods described in CAN/ULC-S770 "Standard Test Method for Determination of Long-Term Thermal Resistance of Closed-Cell Thermal Insulating Foams," or ASTM C1303/1303M "Standard Test Method for Predicting Long-Term Thermal Resistance of Closed Cell Foam Insulation."



2.5. MANUFACTURING

An overview of the manufacturing process for polyiso insulation is illustrated in Figure 3 and is described below.

Manufacturing Process Detail:

- **Raw Material Unloading and Storage** - Raw materials are delivered to the manufacturing plant via bulk shipment methods including rail cars and large totes. After unloading, certain materials are transferred and stored on-site in large tanks or totes.
- **Facer Unwind** - Rolls of facer material are loaded on the front end of the lamination line. Two rolls of material are unwound and fed toward the laminator. The material will become the top and bottom of the finished product.
- **Compounding** - Raw materials are compounded and heated to form the polyol or B-side component of the product formulation. The isocyanate or A-side of the product formulation is heated and transferred through a separate line.
- **Mixing Head and Pour Table** - The A-side and B-side components are mixed with the blowing agent at the mixing head. At the pour table, the mixture is applied through the mixing head applicator and laid onto one layer of the facer material. The chemical reaction begins at this point in the process, and the second layer of the facer material is brought into contact with the foam mixture as it enters the laminator.
- **Laminator** - The chemical reaction transforms the liquid mixture into the rigid foam core as the product moves through the laminator. The laminator is used to control the thickness of the finished product as well as other characteristics such as cell formation, curing, and facer adhesion.
- **Trim and Cutting** - The product is manufactured in a continuous process and must be trimmed and cut after exiting the laminator. A cross-cut saw and gang saw are used to cut the material down to either 4' or 8' finished lengths.
- **Robot Stacker** - A conveyor system moves the polyiso boards through the trimming and cutting process to the robot stacker. An initial quality check is performed as the boards are stacked in bundles.
- **Packaging** - The stacked bundles are transferred to a hooding machine where each bundle is individually wrapped with a plastic film. The factory packaging secures the product for warehouse storage and transport.
- **Foot Station and Warehousing** - The product identification labels are applied to each bundle. A forklift transfers the bundles from the end of the line to warehouse storage. Polyiso boards complete the curing process while stored in the warehouse.
- **Quality Assurance and Control** - Product samples are selected and subjected to various quality assurance and quality control (QA/QC) testing. The QA/QC is performed against applicable standards and internal controls for physical properties including initial R-value, compressive strength, and dimensional stability.
- **Loading and Shipping** - After QA/QC testing and storage in the warehouse, the bundles are transferred to the loading dock. Bundles are loaded onto flatbed trucks and secured for transport to jobsites or distribution locations.

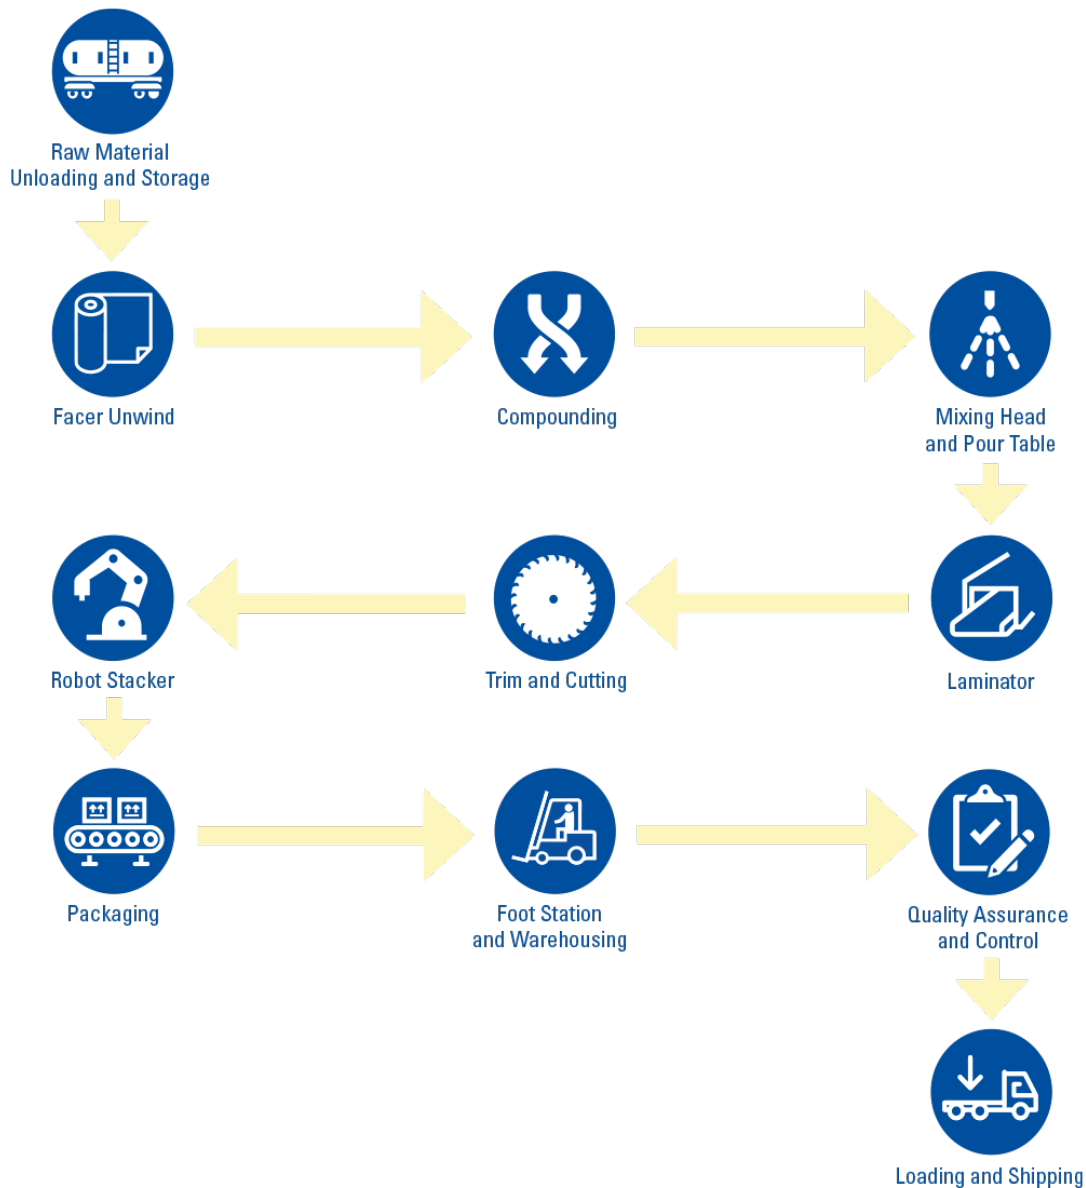


Figure 3: Illustration of the polyiso insulation manufacturing process.

2.6. PROPERTIES OF PRODUCT AS DELIVERED

The manufactured ACFoam® HD CoverBoards are typically shipped and delivered to jobsites stacked in bundles protected by a plastic bag. ACFoam® HD CoverBoard is typically 1.2 m by 2.4 m (4 feet by 8 feet) or 1.2 m by 1.2 m (4 feet by 4 feet) and 12.7-mm thick (0.5-inch thick). ACFoam® HD CoverBoard FR is typically 1.2 m by 2.4 m (4 feet by 8 feet) or 1.2 m by 1.2 m (4 feet by 4 feet) and 15.9 mm thick (0.625-inch thick). Typically, the bundles consist of 42 boards.



2.7. PACKAGING

Bundles of ACFoam® HD CoverBoards are bagged in plastic prior to shipment from the manufacturing facility. Packaging used to wrap/shroud bundles is made from extruded low-density polyethylene (LDPE) film. The bundles may be stacked on wood pallets.

Table 3: Amount of packaging materials for ACFoam® HD CoverBoards per product reference service life (RSL)*.

Material	ACFoam® HD CoverBoards	
	80 psi	Unit
Polyethylene	2.13E-02	kg/m ²
Wood	3.22E-04	kg/m ²

*: RSL is the lifetime of the product (RSL = 40 years for roof products.)

2.8. TRANSPORTATION

The ACFoam® HD CoverBoards are transported in wrapped bundles from the manufacturing facilities to product distributor sites or directly to project jobsites by a diesel-powered truck with a flatbed trailer. The average transport distance from the production facility is 514 km (319 miles). Additional transportation details are reported in Table 8 in the life cycle assessment scenario section of the EPD.

2.9. PRODUCT INSTALLATION

Upon delivery to the jobsite, the bundles of ACFoam® HD CoverBoards are unloaded from the truck to the rooftop using a crane or all-terrain forklift, all packaging is removed, and the individual boards are placed on top of insulation by a roofing crew. The HD boards are secured to the insulation using mechanical fasteners or adhesives, prior to the installation of the roofing membrane. The waste scrap from installation is collected and transported to a local landfill for disposal. Disposal of installation waste scrap to a local landfill was modeled as 7% product loss as prescribed by the PCR.[2] Additional installation details are reported in Table 9 in the life cycle assessment scenario section of the EPD.

2.10. USE CONDITIONS

The use phase follows the installation of ACFoam® HD CoverBoards. In a roofing system, the insulation is located on top of a roof deck and below the roof membrane. If ACFoam® HD CoverBoards are part of the system, they are located on top of insulation and below the roof membrane. The roof membrane, when installed properly and adequately maintained, protects the insulation and the ACFoam® HD CoverBoards from environmental elements (i.e., rainwater) and weather during its use. The ACFoam® HD CoverBoards offer additional protection (i.e., impact resistance) for the insulation below it. Therefore, it is expected that polyiso roof insulation and ACFoam® HD CoverBoards will not sustain damage that affects its performance and function and does not require maintenance.

2.11. PRODUCT REFERENCE SERVICE LIFE AND BUILDING ESTIMATED SERVICE LIFE

As defined in the governing PCR, the Building Estimated Service Life (ESL) is 75 years. The necessary steps for providing weather protection are specified by manufacturer installation instructions and are mandated by model building codes. The roof membrane's useful life span is influenced by many variables including roof system design, quality of the



installation, type and durability of the membrane, roof system component configuration and maintenance as well as weather conditions and events. Assuming that variables are sufficiently addressed through the membrane and the roof system design and installation, the insulation will serve its functional purpose for the 75-year life span of the building. However, the real-world reroofing scenarios, building owner tendencies, and the expected service life of roof membranes all indicate that reroofing activity will take place during the 75-year building ESL.

Reroofing activity may initially occur at 15-30 years after the installation of the original system and be driven by recurring roof leaks that cannot be remedied by patch repairs of the membrane. When reroofing is required, options are available to address the need for a new roof membrane without the need to replace the insulation. The model building codes describe a “Roof Recover” as an acceptable reroofing practice, which occurs when a new roof covering is installed on top of the existing roof system without disturbing or removing the existing roof covering or the insulation below. Roof Recover, as defined by industry practices, involves visual examination and appropriate testing to ensure that all roof components, including insulation, have not sustained damage or deterioration. This approach allows the insulation to be reused instead of being disposed into a landfill. The Roof Recover approach is a common practice in the roofing industry: it is permitted by model building codes and allows the service life of a roof system to be extended (without the need to replace the insulation). However, while the Roof Recover approach is a common practice, it is often not captured in reroofing studies available in the public domain, which typically contemplate a full roof replacement. Pertinent to this declaration, PIMA recognizes a 20-year life span for the original installation of the membrane followed by a Roof Recover, which extends the life of the original roof system to 40 years. This practice, and the PCR, establishes a **40-year product RSL** for polyiso roof insulation boards and HD roof cover boards. In the United States, the model building codes allow a roof to be recovered only once. Where two roof membranes are installed on an existing roof, a reroofing process referred to as a “Roof Replacement” is required. This process involves the removal of all roof components down to the roof deck. Depending on the condition of the insulation or cover board, these materials can be reused on site, resold on secondary markets, or landfilled. Typically, roof demolition is preferred to alleviate the labor required to separate materials for reuse. This study conservatively assumes all insulation is disposed in the landfill during a Roof Replacement. Therefore, the polyiso roof insulation boards’ cradle-to-grave assessment incorporates all life cycle stage environmental impacts connected with the original building construction, a Roof Recover operation at 20 years, as well as the building’s Roof Replacement operation at 40 years. This translates to 0.9 replacement cycles during the **75-year building ESL** ($75\text{-year ESL}/40\text{-year RSL} - 1 = \mathbf{0.9\text{ replacement cycles}}$). In Canada, the National Model Building Codes do not provide guidance or limitations for recovers of existing roofs. Even though the age of roofs may surpass 40 years, the same roof replacement cycle of 40 years is assumed in this study for buildings in Canada.

2.12. RE-USE PHASE

If the product is still in good condition and has not passed its reference service life, it may be reused. No re-use is considered in this EPD.

2.13. DISPOSAL

At the end of the building’s service life, the ACFoam® HD CoverBoards are assumed to be disposed in a landfill and no recycling is considered. The boards are transported 161 km (100 miles) to landfill sites by truck for disposal. Additional disposal details are reported in the Transport to waste disposal (module C2) and Disposal of waste (module C4) tables presented in the scenario section.



3. LCA CALCULATION RULES

3.1. REFERENCE FLOW AND FUNCTIONAL UNIT

The selected functional unit (FU) for this study is: **1 m²** of installed roof cover board, including **7% installation waste**. A building service life of **75 years** and a product **thickness of 12.7 mm (1/2 inch)** are considered. The product thickness selected represents by far the predominant product thickness available on the market.

Table 4 below summarizes the reference flows associated with the functional unit. HD cover boards represent RSI value as per the test method described in ASTM C518. Reference flows, which represent weighted average values, are shown per product reference service life (RSL) and per building estimated service life (ESL). The product weight per product RSL represents: 1 m² of AC Foam® HD CoverBoards without installation loss or replacement. The product weight per building ESL, on the other hand, represents: 1 m² of AC Foam® HD CoverBoards with installation loss and replacement.

For AC Foam® HD CoverBoards, there is a 7% loss at installation and a replacement factor. The reference mass per ESL is calculated as follows:

$$ESL \text{ product weight (kg)} = \frac{RSL \text{ product weight (kg)}}{(100\% - \text{Installation loss (\%)})} * (1 + \text{Replacement})$$

For 80 psi AC Foam® HD CoverBoards, this gives:

$$ESL \text{ product weight (kg)} = \frac{1.848 \text{ kg}}{(100\% - 7\%)} * (1 + 0.9) = 3.775 \text{ kg}$$

Table 4: Reference flows of studied products per reference service life (RSL) and per building estimated service life (ESL) in metric units and imperial units.

Reference flows		AC Foam® HD CoverBoards		AC Foam® HD CoverBoards	
		80 psi	Unit	80 psi	Unit
RSL	Product weight	1.848	kg/m ²	0.378	lb/ft ²
	Facer weight	0.976	kg/m ²	0.200	lb/ft ²
	Foam weight	0.871	kg/m ²	0.178	lb/ft ²
	Thickness	12.7	mm	0.500	inch
	RSI / R-value	0.44	m ² K/W	2.50	ft ² °F h/Btu
ESL	Product weight	3.775	kg/m ²	0.773	lb/ft ²
	Installation loss	7.0%	%	7.0%	%
	Replacement (ESL/RSL-1)	0.900		0.900	

3.2. PRODUCTION AVERAGE

All of Atlas polyiso manufacturing facilities, located in Toronto (ON), Vancouver (BC), Camp Hill (PA), Diboll (TX), East Moline (IL), LaGrange (GA), Northglenn (CO), and Phoenix (AZ), participated in the product-specific EPD. A vertical mass-weighted average was calculated based on the LCA results obtained from 8 facilities, regardless of their size, which provided their production data for the full 2023 calendar year. Products were classified based on their ASTM C1289 type, class, facer material, and compressive strength. Products within the same classification group are treated as equivalent because they share the same technical characteristics and are represented by the same underlying life cycle assessment model; hence, considered product-specific EPD.

3.3. ESTIMATES AND ASSUMPTIONS

The table below presents the datasets selected to represent the polyiso foam raw materials.

Table 5: Datasets selected to represent polyiso insulation raw materials.

Material	Data source	Data Reference Year
MDI	American Chemistry Council (ACC), 2022, cradle-to-gate LCI study: LCIA results (mass and elemental alloc.)	2015 - 2017
Polyester Polyol	Primary data	2023
Blowing agent	Ecoinvent dataset 3.9.1: pentane production pentane Cutoff, U - RoW	2001 - 2022
Flame retardant	TCPP GABi database: Tris(2-chloroisopropyl)phosphate (TCPP) - US	2018
Surfactant	Ecoinvent 3.9.1 datasets (for 1 kg of surfactant) 0.4 kg polydimethylsiloxane production polydimethylsiloxane Cutoff, U – GLO 0.6 kg polyol production polyol Cutoff, U - RoW	2015 - 2022
Catalyst	Ecoinvent 3.9.1 datasets (for 1 kg of catalyst) 0.5 kg ethanolamine production triethanolamine Cutoff, U - RoW	2000 - 2022
	0.29 kg potassium hydroxide production potassium hydroxide Cutoff, U - RoW	1998 – 2022
	USLCI dataset*: 0.31 kg Acetic acid, at plant/kg/RNA	2002
CGF Facer	Primary data	2023

*Cut-off processes have been filled with ecoinvent data.

3.4. SYSTEM BOUNDARIES

The system boundaries are **cradle-to-gate with options**, i.e., cover the production, construction, and end-of-life life cycle stages as well as module B4.[2] Information modules B1, B2, B3, B5, B6, and B7 are assumed to be zero for this product category. Figure 4 presents the process flow diagram for ACFoam® HD CoverBoards. Neither renewable energy credits nor carbon credits are used within the scope of this project.

It should be noted that the industry and Atlas also published EPDs for polyiso wall insulation boards and polyiso roof insulation boards. Those EPDs were published according to a different PCR, i.e., UL Solutions Part B PCR for Building Envelope Thermal Insulation products.[9] That PCR requires reporting of blowing agent emissions during the use of the product (module B1). To ensure consistency in EPD results of polyiso products, emissions during product use (module B1) are also reported in this EPD.

**Table 6: Description of the system boundary life cycle stages and related information modules.**

PRODUCTION STAGE			CONSTRUCTION PROCESS STAGE		USE STAGE							END-OF-LIFE STAGE			
A1	A2	A3	A4	A5	B1	B2	B3	B4	B5	B6	B7	C1	C2	C3	C4
Extraction and Upstream Production	Transport to Factory	Manufacturing	Transport to Site	Installation	Use	Maintenance	Repair	Replacement	Refurbishment	Operational Energy Use	Operational Water Use	Deconstruction / Demolition	Transport to Waste Processing or Disposal	Waste Processing	Disposal of Waste
X	X	X	X	X	X*	X	X	X**	X	X	X	X	X	X	X

Key: X = included; MND = module not declared (excluded).

*: Required for wall and roof insulation board EPD. Shown as additional information for ACFoam® HD CoverBoards.

**: Roofing applications have a reference service life of 40 years for a 75-year building estimated service life; hence, a replacement of 0.9 is considered.

Production (modules A1 to A3)

Extraction and upstream production (module A1): This module includes the extraction and transformation of raw materials needed to produce polyiso products.

Transport to factory (module A2): This module includes the transportation of raw materials from suppliers to the manufacturing facilities.

Manufacturing (module A3): This module includes water and energy (electricity, natural gas, diesel) consumption for the manufacturing processes and building requirements (lighting, heating, cooling). Ancillary materials used in the polyiso manufacturing process and their transport from the suppliers to the manufacturing facilities have been considered here, as well as packaging materials to make the products ready for shipment. Blowing agent emissions from the production process and from the polyiso board cuttings are also included in this module, as well as the waste transport to the waste treatment center and the waste treatment itself. The majority of the manufacturing waste is sent to landfill.

Construction (modules A4 to A5)

Delivery and installation: These modules included the delivery of the product to the client and their installation. Product loss during the installation of ACFoam® HD CoverBoards is 7%.[2] Waste generated during installation, such as product loss and packaging, are considered landfilled. Transport and treatment of waste are included. It should be noted that the production (modules A1 to A3) and delivery (module A4) of lost products are included in module A5.

Use (modules B1 to B7)

Use: Module B1 includes pentane emissions during the use phase and module B4 includes replacement for roofing product applications. Modules B2, B3, B5, B6, and B7 are "null" for the purpose of the EPDs.

End-of-Life (modules C1 to C4)

End-of-life: This stage includes modules C2 and C4, transport to and treatment of waste at inert material landfill, respectively. Modules C1 and C3 modules are "null."

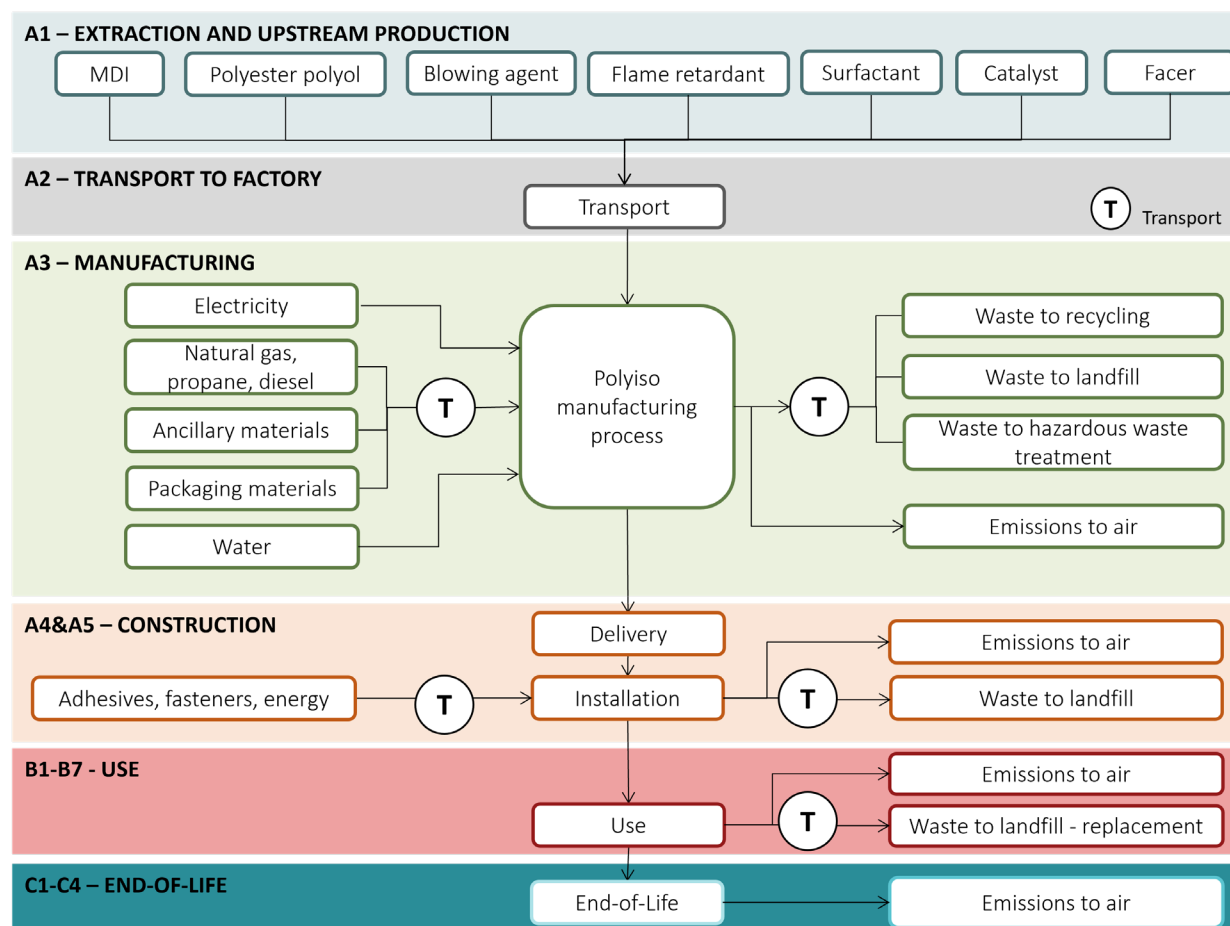


Figure 4: Cradle-to-gate with options system boundaries of polyiso product LCA.

3.5. CUT-OFF CRITERIA

According to ISO 21930:2017, cut-off rules shall not be applied in order to hide data. All data shall be included. In the case of insufficient data, the cut-off criteria shall be 1% of energy or 1% of total mass input and 1% of environmental impacts of the unit process. The total cut-off input flows per module shall be a maximum of 5% energy, mass, and environmental impacts.

No known flows are deliberately excluded from this study.

For this study, no data on the construction, maintenance, or dismantling of the capital assets, daily transport of employees, office work, business trips, or other employee activities were included in the model. The model only takes into account the processes associated with infrastructures that are already included in theecoinvent unit processes.

3.6. ALLOCATION

Whenever possible, allocation should be avoided by collecting data related to the process under study or by expanding the product system. When allocation cannot be avoided, according to UL Solutions Part B PCR, mass allocation should be used.[2]



Energy consumption, ancillary materials, and packaging materials were provided for the entire manufacturing facilities; thus, **mass allocation** was used. Otherwise, no co-product allocation was required.

Waste processing of the material flows undergoing **recycling processes** are included up to the system boundary of the end-of-waste.[6] In other words, a **cut-off approach** was used as further processing of the recycled material is part of the raw material preparation of another product system (open-loop recycling).

Blowing agent (pentane) emissions during the life cycle of the product were calculated from primary data and PCR blowing agent emission allocation factors to preserve mass balance.[9] The calculated blowing agent emission allocation factors are shown in the table below.

Table 7: Calculated pentane emission allocation factors per information module.

	A3	A5	B1	C4	Remains in material
HD Polyiso Roof Cover Boards	5.9%	7.0%	18.7%	68.4%	0%

The Roof Cover Protection Board PCR does not specify how to deal with pentane emissions and, furthermore, sets module B1 to zero. To harmonize the life cycle assessment information of the polyiso board products, the approach presented in the Building Envelope Thermal Insulation PCR is used for ACFoam® HD CoverBoards. This adds consistency between all the polyiso board product LCA analysis and the EPDs.

3.7. CALCULATION METHOD

The openLCA software v2.03 [12], an open-source software, was used to calculate the inventory and to assess potential environmental impacts associated with the inventoried emissions.



3.8. DATA SOURCES AND QUALITY REQUIREMENTS

Data Source/Quality Parameter	Data Source/Quality Discussion
Source of manufacturing data (primary data)	Manufacturing data was collected from 8 manufacturing plants located in North America for the 2023 production year. This data included: total annual mass of products produced at the manufacturing plants; specific product composition; raw materials and fuels entering the product production process; transport distance of materials and fuels; electricity consumption; water consumption; emissions to the environment at the manufacturing plant; and packaging.
Source of secondary data (background data)	MDI: American Chemistry Council (ACC), 2022, cradle-to-gate LCI study: LCIA results (mass and elemental allocation) Polyester Polyol and facer: primary data Flame retardant: GaBi Catalyst: ecoinvent 3.9.1 and US LCI Pentane, surfactant, energy use, transport, waste treatment and packaging: ecoinvent 3.9.1
Geographical representativeness	Manufacturing facilities are based in North America; hence electricity consumption is based on each facility's regional grid mix and natural gas consumption from the Canadian or US high-pressure natural gas market as appropriate. Geographical correlation of the material supply and the selected datasets are largely representative of the same area. When this was not possible, datasets representing a larger geographical area were used.
Temporal representativeness	Primary data was collected from the polyiso manufacturers and their specific facilities for the full 2023 calendar year. Datasets selected were almost all from a time period ending within the last ten years.
Technological representativeness	Primary data, obtained from the polyiso manufacturer, is representative of the current technologies and materials used by their company.
Completeness	All relevant process steps were considered and modeled to satisfy the goal and scope. No known flows were cut off.
Consistency	The same data was collected from all facilities, the same data treatment was applied to all facilities and, as a vertical mass-weighted average was calculated based on the LCA results obtained from facilities, the same model was used for all facilities; hence, the consistency of this study is high.
Reproducibility	Given access to the LCA report and the quality-checked primary data of all facilities, an independent practitioner would be able to reproduce the results as calculation rules and model details are reported in detail in the LCA report.

4. LIFE CYCLE ASSESSMENT SCENARIO

4.1. TRANSPORT TO INSTALLATION SITE (MODULE A4)

Primary data was collected from each participating manufacturer regarding product transport to installation sites or distributors (transport distance and transport mode).

Table 8: Transport to building site assumptions (module A4).

Name	Manufactured boards	Unit
Fuel type	Diesel	
Vehicle type*	53' Tractor-trailer	
Litres of fuel**	~ 35	L/ 100 km
Transport distance***	514	km
Capacity utilization (including empty runs, mass-based)	50	%
Gross density of products transported	145.5	kg/m ³
Capacity utilization volume factor	1	

* Modelled using ecoinvent 3.9.1 dataset "transport, freight, lorry >32 metric ton, EURO6 | transport, freight, lorry >32 metric ton, EURO6 | Cutoff, U – RoW."

** According to the Handbook of Emission Factors for Road Transport (<https://www.hbefa.net/>), a 32 metric ton, EURO6, lorry has a fuel consumption around 35 L/100km.

*** From primary data, represents the mass weighted average.

4.2. INSTALLATION (MODULE A5)

UL Solutions Part B PCR is prescriptive on product losses during installation.[2] Installation assumptions (ancillary materials, electricity consumption, diesel fuel consumption) were taken from the UL Solutions Part B PCR Building Envelope Thermal Insulation to harmonize the polyiso EPDs.[9] Details are presented in Table 9. Waste product and packaging are considered non-hazardous waste sent to inert landfill by refuse truck over 161 km. The packaging waste, a low fraction of the Construction & Demolition (C&D) waste, is difficult to separate and recover; thus, packaging waste is considered all sent to landfill.[10] Biogenic carbon is considered emitted from wood pallets and, apart from pentane emissions, no other VOC emissions are considered emitted in A5, nor were any VOC emissions tests performed.

Table 9: Installation into the building site assumption (module A5).

Name	Manufactured boards	Unit
Ancillary materials	0.0012 Fasteners 0.0012 Adhesive	kg
Electricity consumption	0.012	kWh
Diesel fuel for onboard generators	0.37	MJ
Product loss	7%	%
Pentane emissions	0.00176	kg
Product waste at the construction site before waste processing, generated by product installation	0.139	kg
LDPE packaging waste	0.023	kg
Wood packaging waste	0.00035	kg
Biogenic carbon content in packaging*	0.00064	kg CO ₂

* Wood pallets are considered to contain 50% carbon.



4.3. USE (MODULE B1)

The use phase only includes pentane emissions. According to the UL Solutions Part B PCR: Building Insulation,[9] 21.5% of the pentane in the installed product is emitted during the use phase and the balance at disposal (module C4).

4.4. REPLACEMENT (MODULE B4)

Roofing products, which have a reference service life (RSL) of 40 years, have a replacement cycle of 0.9. The estimated service life (ESL) of the building is 75 years. The replacement cycle in Table 10 represents the additional quantity of product produced in the production life cycle stage (modules A1-A3) necessary to meet replacement needs throughout the building's estimated service life (ESL), their transport to the installation site, their installation, as well as the end-of-life stage of the original boards replaced. In other words, the replacement module B4 is equal to the sum of modules C1, C2, C3, and C4 multiplied by 1/0.9 and the sum of modules A1, A2, A3, A4, and A5 multiplied by 0.9. Refer to appropriate module scenario of the report for detailed information.

Table 10: Replacement (module B4).

Name	Roofing application	Unit
Building's Estimated Service Life (ESL)	75	years
Reference Service Life (RSL)	40	years
Replacement cycle*	0.9	N/A

* The replacement cycle is calculated with the following equation $(ESL/RSL) - 1$. The result is rounded-up to the nearest tenth of the building's ESL.

4.5. END-OF-LIFE (MODULES C1-C4)

At their end-of-life, ACFoam® HD CoverBoards are removed and transported to a landfill.

ACFoam® HD CoverBoards do not require waste processing. In addition, potential environmental impacts associated with the deconstruction of polyiso boards are considered negligible compared to the potential environmental impacts of the deconstruction of the whole building; hence, module C1 is considered null.

Table 11: End-of-life (modules C1-C4).

Name		Manufactured boards	Unit
Transport		161	km
Collection process *	Collected with mixed construction waste	1.843	kg
Disposal **	Product for final disposal (100% landfill)	1.826	kg
Blowing agent emissions		0.017	kg

* Mass adjusted to account for mass loss due to off-gassing in module B1. Values per product reference service life (RSL).

**Mass adjusted to account for mass of pentane loss in modules B1 and C4, which is 100% of the pentane in product. Values per product reference service life (RSL).



5. LIFE CYCLE ASSESSMENT RESULTS

5.1. RESULTS TABLES

It should be noted that Life Cycle Impact Assessment (LCIA) results are relative expressions and do not predict impacts on category endpoints, the exceeding of thresholds, safety margins, or risks.

The reported six impact categories are globally deemed mature enough to be included in Type III environmental declarations. Other categories are being developed and defined and LCA should continue making advances in their development. However, the EPD users shall not use additional measures for comparative purposes.

The tables below present the LCIA results according to the product functional unit using the TRACI methodology (GWP from IPCC AR5, ADP-ff from CML 4.8), as well as primary energy consumption, consumption of renewable and non-renewable materials, water consumption, and waste generation. EPA updated TRACI in 2021 to include spatially-specific eutrophication factors. All other indicators remain the same from version 2.1; hence, as an optional additional indicator, Eutrophication Potential from TRACI 2.1 is shown for information purposes. It should be noted that, except for roofing applications where replacement impacts are reported in module B4, modules B2 – B7 are reported as zero, as are modules C1 and C3 as they have no associated impacts.

TRACI 2.2 potential impact indicators

GWP: Global Warming Potential; **ADP-ff:** Abiotic Resource Depletion Potential of Non-Renewable (Fossil) Energy Resources; **AP:** Acidification Potential; **EP_f:** Eutrophication Potential – Freshwater; **EP_m:** Eutrophication Potential – Marine; **ODP:** Ozone Layer Depletion Potential; **SFP:** Smog Formation Potential.

Resource use

RPR_E: Renewable Primary Resources Used as Energy Carrier (Fuel); **RPR_M:** Renewable Primary Resources with Energy Content Used as Material; **RPR_T:** Renewable Primary Resources Total; **NRPR_E:** Non-Renewable Primary Resources Used as Energy Carrier (Fuel); **NRPR_M:** Non-Renewable Primary Resources with Energy Content Used as Material; **NRPR_T:** Non-Renewable Primary Resources Total; **SM:** Secondary Materials; **RSF:** Renewable Secondary Fuels; **NRSF:** Non-Renewable Secondary Fuels; **RE:** Recovered Energy; **FW:** Use of Net Fresh Water Resources.

Output flows and waste categories

HWD: Hazardous Waste Disposed; **NHWD:** Non-Hazardous Waste Disposed; **HLRW:** High-Level Radioactive Waste, Conditioned, to Final Repository; **ILLRW:** Intermediate and Low-Level Radioactive Waste, Conditioned, to Final Repository; **CRU:** Components for Re-Use; **MFR:** Materials for Recycling; **MER:** Materials for Energy Recovery; **EE:** Exported Energy.

Additional indicator – TRACI 2.1

EP: Eutrophication Potential



Table 12: Cradle-to-gate with options LCA results for 1 m² of installed 12.7-mm thick ACFoam® HD CoverBoard, including 7% installation waste, CGF, 80 psi, with a building service life of 75 years.

Environmental indicator		Unit	A1	A2	A3	A4	A5	B1*	B4	C2	C4
			(per m2)	(per m2)	(per m2)	(per m2)	(per m2)	(per m2)	(per m2)	(per m2)	(per m2)
IPCC AR5 and TRACI 2.2	GWP ⁽¹⁾	kg CO ₂ eq.	4.21E+00	1.82E-01	3.85E-01	9.50E-02	4.31E-01	0.00E+00	5.20E+00	3.71E-01	1.00E-02
	GWP _{fossil} ⁽¹⁾	kg CO ₂ eq.	4.18E+00	1.82E-01	3.85E-01	9.50E-02	4.29E-01	0.00E+00	5.16E+00	3.71E-01	1.00E-02
	GWP _{biogenic} ⁽¹⁾	kg CO ₂ eq.	7.38E-03	5.82E-05	2.73E-04	2.82E-05	6.29E-04	0.00E+00	7.58E-03	3.77E-05	4.06E-06
	GWP _{LU&LUT} ⁽¹⁾	kg CO ₂ eq.	2.45E-02	1.08E-04	4.08E-04	4.92E-05	1.92E-03	0.00E+00	2.44E-02	4.66E-05	5.94E-06
	ADP-ff ⁽²⁾	MJ, LHV	8.54E+01	2.55E+00	5.96E+00	1.44E+00	8.03E+00	0.00E+00	9.86E+01	4.80E+00	2.48E-01
	AP	kg SO ₂ eq.	1.39E-02	1.10E-03	1.02E-03	2.28E-04	1.66E-03	0.00E+00	1.82E-02	1.85E-03	6.75E-05
	EP _f	kg P eq.	7.46E-04	1.58E-05	8.20E-05	7.63E-06	7.12E-05	0.00E+00	8.39E-04	6.52E-06	7.84E-07
	EP _m	kg N eq.	9.55E-03	1.08E-03	9.16E-04	1.70E-04	1.40E-03	0.00E+00	1.44E-02	2.26E-03	7.34E-05
	ODP	kg CFC-11 eq.	3.78E-06	3.07E-09	4.27E-09	1.76E-09	2.87E-07	0.00E+00	3.68E-06	6.12E-09	3.07E-10
	SFP	kg O ₃ eq.	2.45E-01	2.78E-02	2.67E-02	4.79E-03	3.84E-02	1.18E-02	4.02E-01	6.14E-02	2.23E-02
Resource use	RPR _E ⁽³⁾	MJ, LHV	2.79E+00	4.85E-02	4.28E-01	2.06E-02	2.74E-01	0.00E+00	3.23E+00	2.12E-02	2.40E-03
	RPR _M ⁽⁴⁾	MJ, LHV	1.03E-02	0.00E+00	0.00E+00	0.00E+00	7.73E-04	0.00E+00	9.94E-03	0.00E+00	0.00E+00
	RPR _T	MJ, LHV	2.80E+00	4.85E-02	4.28E-01	2.06E-02	2.75E-01	0.00E+00	3.24E+00	2.12E-02	2.40E-03
	NRPR _E ⁽⁵⁾	MJ, LHV	5.02E+01	2.58E+00	6.61E+00	1.45E+00	5.46E+00	0.00E+00	6.53E+01	4.80E+00	2.49E-01
	NRPR _M ⁽⁶⁾	MJ, LHV	3.99E+01	0.00E+00	0.00E+00	0.00E+00	3.03E+00	0.00E+00	3.87E+01	0.00E+00	0.00E+00
	NRPR _T	MJ, LHV	9.02E+01	2.58E+00	6.61E+00	1.45E+00	8.49E+00	0.00E+00	1.04E+02	4.80E+00	2.49E-01
	SM	kg	3.20E-02	0.00E+00	0.00E+00	0.00E+00	2.41E-03	0.00E+00	3.10E-02	0.00E+00	0.00E+00
	RSF	MJ, LHV	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00
	NRSF	MJ, LHV	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00
	RE	MJ, LHV	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00
FW ⁽⁷⁾	m ³	2.99E-02	3.74E-04	2.27E-03	2.08E-04	2.71E-03	0.00E+00	3.25E-02	2.34E-04	2.63E-04	
Output flows and waste categories	HWD ⁽⁸⁾	kg	2.65E+00	8.53E-02	4.30E-01	4.16E-02	2.78E-01	0.00E+00	3.18E+00	3.47E-02	4.17E-03
	NHWD ⁽⁹⁾	kg	5.32E-01	1.50E-01	4.90E-02	1.23E-01	1.26E-01	0.00E+00	2.74E+00	2.34E-02	1.64E+00
	HLRW ⁽¹⁰⁾	m ³	5.99E-09	3.58E-11	9.29E-10	1.71E-11	5.65E-10	0.00E+00	6.81E-09	1.93E-11	1.95E-12
	ILLRW ⁽¹¹⁾	m ³	4.66E-08	1.90E-10	2.67E-09	9.01E-11	3.93E-09	0.00E+00	4.83E-08	9.82E-11	1.05E-11
	CRU	kg	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00
	MFR	kg	4.72E-02	0.00E+00	2.11E-03	0.00E+00	3.71E-03	0.00E+00	4.77E-02	0.00E+00	0.00E+00
	MER	kg	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00
	EE	MJ, LHV	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00
Additional indicator – TRACI 2.1											
EP	kg N eq.	1.05E-02	2.00E-04	7.30E-04	8.27E-05	9.66E-04	0.00E+00	1.15E-02	1.94E-04	1.16E-05	

*: Required for wall and roof insulation board EPD. Shown as additional information for ACFoam® HD CoverBoards.



Table notes

- (1) GWP 100, excludes biogenic CO₂ removals and emissions associated with biobased products and packaging; 100-year time horizon GWP factors are provided by the IPCC 2013 Fifth Assessment Report (AR5). GWP_{biogenic} includes biogenic methane emissions to air, while GWP_{LU&LUT} includes carbon dioxide emissions to air from land transformation and to soil or biomass stock, as well as methane emissions to air from soil or biomass stock.
- (2) Abiotic Resource Depletion Potential of non-renewable (fossil) energy resources (ADP-ff, in MJ, LHV) is based on CML-baseline, v4. August 2016.
- (3) $RPR_E = RPR_T - RPR_M$, where RPR_T is equal to the value for renewable energy obtained using the CED methodology (LHV).
- (4) Calculated as per ACLCA ISO 21930 Guidance, 6.2 Renewable primary resources with energy content used as a material, RPR_M .
- (5) $NRPR_E = NRPR_T - NRPR_M$, where $NRPR_T$ is equal to the value for non-renewable energy obtained using the CED methodology (LHV).
- (6) Calculated as per ACLCA ISO 21930 Guidance, 6.4 Non-renewable primary resources with energy content used as a material, $NRPR_M$.
- (7) Represents the use of net fresh water calculated from life cycle inventory results, i.e., water consumption using ReCiPe Midpoint (E) 2016.
- (8) Calculated from life cycle inventory results, based on datasets classified under "treatment and disposal of hazardous waste." The manufacturer does not generate hazardous waste.
- (9) Calculated from life cycle inventory results, based on waste that is neither "hazardous" nor "radioactive" and EPD values.
- (10) Calculated from life cycle inventory results, based onecoinvent waste flow "high-level radioactive waste for final repository." The manufacturer does not generate radioactive waste.
- (11) Calculated from life cycle inventory results, based onecoinvent waste flow "low-level radioactive waste for final repository." The manufacturer does not generate radioactive waste.



5.2. INTERPRETATION

This section details the contribution to the potential environmental impacts and resource use of the different information modules. As can be seen from the figure below, replacement (module B4) is the main contributor to all potential impact categories, except ozone layer depletion (ODP), as well as renewable and non-renewable resource consumption. It should be noted that module B4 is equal to the replacement factor multiplied by the sum of modules A1-A5 plus the sum of modules C1-C4 of the initial installed product; hence, extraction and upstream production (module A1) is, in fact, the main contributor to all potential impact categories, as well as renewable and non-renewable resource consumption.

Furthermore, the sensitivity analysis indicated that variations in foam density, facer density, and the quantities of MDI, polyol, and surfactants influence the potential environmental impacts across one or more impact categories. These sensitive parameters affect the quantity of raw materials used, which the contribution analysis identified as the primary drivers of environmental impacts in several categories.

Therefore, modifications to the datasets selected to represent the various polyiso raw materials—particularly facer material, MDI, polyol, and surfactants—may alter the results.

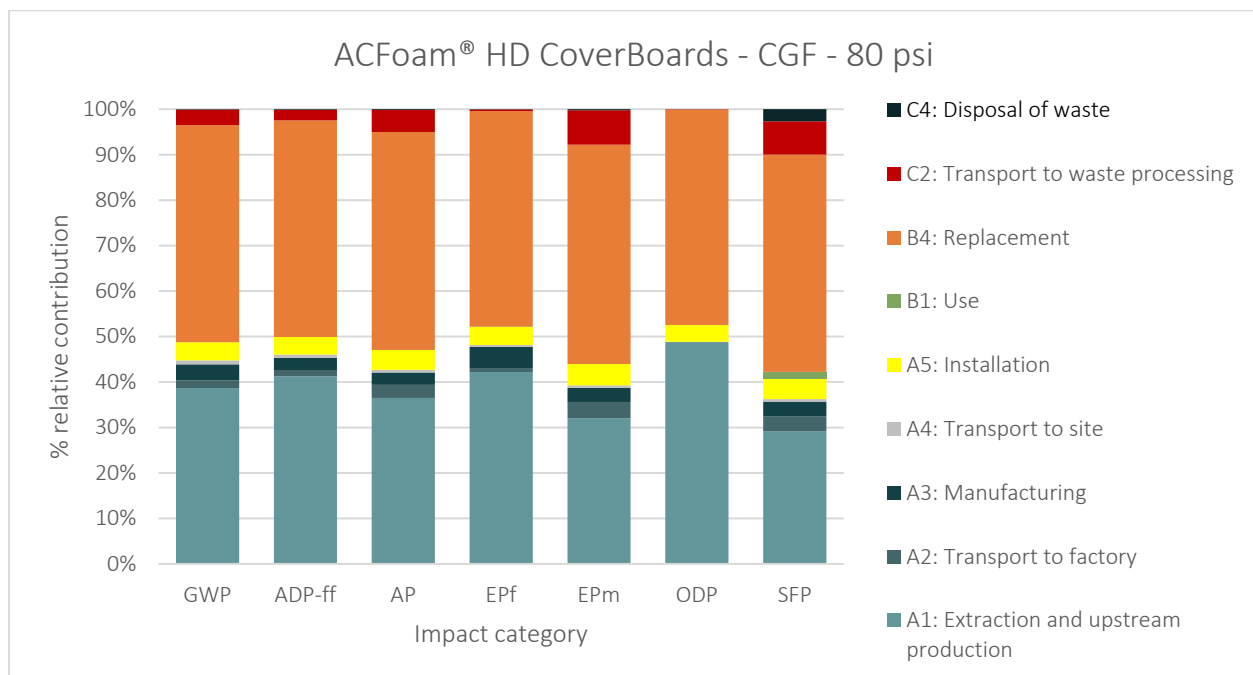


Figure 5: Contribution of life cycle information modules to the potential environmental impacts of 1m² of installed ACFoam® HD CoverBoards, CGF, 80 psi, for 75 years.



6. ADDITIONAL ENVIRONMENTAL INFORMATION

6.1. CONTENT OF REGULATED HAZARDOUS SUBSTANCES

Polyiso products contain pentane or pentane blend blowing agent (2.6%).

6.2. RELEASE OF DANGEROUS SUBSTANCES FROM CONSTRUCTION PRODUCTS

Pentane and pentane blends blowing agent is considered to off-gas very slowly over years/decades during the use and the end-of-life of polyiso products. Freshly expanded or heated foam may off-gas some pentane-blowing agent, which is heavier than air and may accumulate to ignitable concentrations if stored inside a sealed container or within confined areas. Installation methods which include cutting and mechanical fastening may release the blowing agent retained in the product. Provide adequate ventilation to assure localized concentrations in release areas are maintained below the lower flammability limit. Good housekeeping and controlling of dust are necessary for the safe handling of products.

Fire Performance: The fire performance of low-slope roof assemblies is evaluated using assembly tests (that include the roof deck and all materials above it) with respect to both external and internal fire exposure. The fire exposures in tests simulate the type of fire exposure a roof may encounter during its service life, including interior building fires or exterior hazards. The resistance of a roof system to external fire exposure is evaluated using ASTM E108 “Standard Test Methods for Fire Tests of Roof Coverings,” UL 790 “Standard Test Methods for Fire Tests of Roof Coverings” or the Canadian equivalent, CAN/ULC-S107 “Methods of Fire Tests of Roof Coverings.” The test methods provide a basis for comparing roof assemblies under a simulated exterior fire. Roof assemblies restricted to non-combustible decks require only the spread-of-flame test, while roof assemblies used on combustible decks are evaluated for spread of flame, intermittent flame, and the burning brand tests. Roof assemblies can achieve a Class A, B, or C classification. Class A designates the resistance to relatively severe fire-test exposure. Class B designates resistance to relatively moderate fire-test exposure. Class C designates resistance to relatively light fire-test exposure.

Fires can also originate within the building interior and roof system response to fire exposure originating from the interior of the building may be evaluated using NFPA 276 “Standard Method of Fire Test for Determining the Heat Release Rate of Roofing Assemblies with Combustible Above-Deck Roofing Components,” FM Approval 4470 “Single-Ply, Polymer-Modified Bitumen Sheet, Built-Up Roof (BUR) and Liquid Applied Roof: Assemblies for Use in Class 1 and non-combustible Roof Deck Construction,” UL 1256 “Fire Test of Roof Deck Construction,” or CAN/ULC-S126 “Standard Method of Test for Fire Spread Under Roof-Deck Assemblies.” The passing criteria is established by a limit-of-fuel contribution within a designated time period. Polyiso remains the only foam plastic roof insulation to earn FM Class 1 approval for direct-to-steel deck applications when tested in accordance with FM Approval 4470. Polyiso is also classified by UL under UL 1256 for direct-to-steel deck applications with both single-ply and asphalt-based roof coverings.



6.3. RESULTS FOR PRODUCT 15.875 MM (0.675-INCH) THICK

Table 13: Cradle-to-gate with options LCA results for 1 m² of installed 15.875-mm thick ACFoam® HD CoverBoard FR, including 7% installation waste, CGF, 80 psi, with a building service life of 75 years (RSI = 0.53 m² K/W).

Environmental indicator		Unit	A1	A2	A3	A4	A5	B1*	B4	C2	C4
			(per m2)	(per m2)	(per m2)	(per m2)	(per m2)	(per m2)	(per m2)	(per m2)	(per m2)
IPCC AR5 and TRACI 2.2	GWP ⁽¹⁾	kg CO ₂ eq.	4.86E+00	2.03E-01	4.29E-01	1.06E-01	4.87E-01	0.00E+00	5.95E+00	4.09E-01	1.10E-02
	GWP _{fossil} ⁽¹⁾	kg CO ₂ eq.	4.82E+00	2.03E-01	4.28E-01	1.06E-01	4.84E-01	0.00E+00	5.91E+00	4.09E-01	1.10E-02
	GWP _{biogenic} ⁽¹⁾	kg CO ₂ eq.	8.58E-03	6.50E-05	3.05E-04	3.15E-05	7.22E-04	0.00E+00	8.78E-03	4.16E-05	4.47E-06
	GWP _{LU&LUT} ⁽¹⁾	kg CO ₂ eq.	3.06E-02	1.20E-04	4.55E-04	5.50E-05	2.38E-03	0.00E+00	3.03E-02	5.14E-05	6.54E-06
	ADP-ff ⁽²⁾	MJ, LHV	1.01E+02	2.85E+00	6.64E+00	1.61E+00	9.30E+00	0.00E+00	1.15E+02	5.30E+00	2.73E-01
	AP	kg SO ₂ eq.	1.60E-02	1.22E-03	1.14E-03	2.55E-04	1.84E-03	0.00E+00	2.08E-02	2.04E-03	7.44E-05
	EP _f	kg P eq.	8.63E-04	1.77E-05	9.17E-05	8.53E-06	8.10E-05	0.00E+00	9.65E-04	7.19E-06	8.63E-07
	EP _m	kg N eq.	1.10E-02	1.21E-03	1.01E-03	1.90E-04	1.54E-03	0.00E+00	1.64E-02	2.49E-03	8.09E-05
	ODP	kg CFC-11 eq.	4.72E-06	3.43E-09	4.75E-09	1.96E-09	3.58E-07	0.00E+00	4.59E-06	6.75E-09	3.38E-10
	SFP	kg O ₃ eq.	2.83E-01	3.11E-02	2.98E-02	5.35E-03	4.26E-02	1.47E-02	4.60E-01	6.77E-02	2.76E-02
Resource use	RPR _E ⁽³⁾	MJ, LHV	3.27E+00	5.42E-02	4.80E-01	2.31E-02	3.15E-01	0.00E+00	3.75E+00	2.34E-02	2.64E-03
	RPR _M ⁽⁴⁾	MJ, LHV	1.03E-02	0.00E+00	0.00E+00	0.00E+00	7.73E-04	0.00E+00	9.94E-03	0.00E+00	0.00E+00
	RPR _T	MJ, LHV	3.28E+00	5.42E-02	4.80E-01	2.31E-02	3.16E-01	0.00E+00	3.76E+00	2.34E-02	2.64E-03
	NRPR _E ⁽⁵⁾	MJ, LHV	5.66E+01	2.88E+00	7.37E+00	1.62E+00	6.05E+00	0.00E+00	7.34E+01	5.29E+00	2.74E-01
	NRPR _M ⁽⁶⁾	MJ, LHV	4.93E+01	0.00E+00	0.00E+00	0.00E+00	3.74E+00	0.00E+00	4.77E+01	0.00E+00	0.00E+00
	NRPR _T	MJ, LHV	1.06E+02	2.88E+00	7.37E+00	1.62E+00	9.79E+00	0.00E+00	1.21E+02	5.29E+00	2.74E-01
	SM	kg	3.20E-02	0.00E+00	0.00E+00	0.00E+00	2.41E-03	0.00E+00	3.10E-02	0.00E+00	0.00E+00
	RSF	MJ, LHV	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00
	NRSF	MJ, LHV	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00
	RE	MJ, LHV	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00
	FW ⁽⁷⁾	m ³	3.45E-02	4.18E-04	2.54E-03	2.33E-04	3.09E-03	0.00E+00	3.73E-02	2.58E-04	2.90E-04
Output flows and waste categories	HWD ⁽⁸⁾	kg	2.89E+00	9.53E-02	4.80E-01	4.65E-02	3.01E-01	0.00E+00	3.48E+00	3.83E-02	4.60E-03
	NHWD ⁽⁹⁾	kg	5.74E-01	1.68E-01	5.41E-02	1.38E-01	1.39E-01	0.00E+00	3.06E+00	2.58E-02	1.81E+00
	HLRW ⁽¹⁰⁾	m ³	6.77E-09	4.01E-11	1.04E-09	1.92E-11	6.33E-10	0.00E+00	7.68E-09	2.12E-11	2.15E-12
	ILLRW ⁽¹¹⁾	m ³	5.26E-08	2.13E-10	2.99E-09	1.01E-10	4.40E-09	0.00E+00	5.44E-08	1.08E-10	1.16E-11
	CRU	kg	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00
	MFR	kg	4.72E-02	0.00E+00	2.32E-03	0.00E+00	3.72E-03	0.00E+00	4.79E-02	0.00E+00	0.00E+00
	MER	kg	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00
	EE	MJ, LHV	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00
Additional indicator – TRACI 2.1											
	EP	kg N eq.	1.20E-02	2.23E-04	8.16E-04	9.25E-05	1.09E-03	0.00E+00	1.31E-02	2.13E-04	1.27E-05

*: Required for wall and roof insulation board EPD. Shown as additional information for ACFoam® HD CoverBoards.



6.4. BENCHMARKING AGAINST THE INDUSTRY-AVERAGE RESULTS

Atlas product-specific EPDs were prepared with the same model as the PIMA industry-average EPDs; hence, results may be compared. The difference between results is calculated as follows:

$$\text{Difference (\%)} = \frac{(\text{Atlas's product-specific} - \text{PIMA industry-average})}{\text{PIMA industry-average}} * 100\%$$

For example, for Atlas's polyiso roof insulation board at 20 psi with coated glass facer (A1 - A3) global warming potential (GWP) results compared to PIMA's polyiso roof insulation board at 20 psi with coated glass facer (A1 - A3) global warming potential (GWP) result, the difference is -1.3%:

$$\text{Difference (\%)} = \frac{(4.78 - 4.78)}{4.78} * 100\% = -0.2\%$$

Results by product for A1-A3 and A1-C4 are shown in the tables below.

Table 14: Atlas ACFoam® HD CoverBoards product-specific global warming potential (GWP) A1-A3 results compared to PIMA industry-average results.

Product	Unit	PIMA Industry-average A1-A3	Atlas's product-specific A1-A3	Difference
		80 psi (per m2)	80 psi (per m2)	%
HD - CGF	kg CO ₂ eq.	4.78E+00	4.78E+00	-0.2%

Table 15: Atlas ACFoam® HD CoverBoards product-specific global warming potential (GWP) A1-C4 results compared to PIMA industry-average results.

Product	Unit	PIMA Industry-average A1-C4	Atlas's product-specific A1-C4	Difference
		80 psi (per m2)	80 psi (per m2)	%
HD - CGF	kg CO ₂ eq.	1.09E+01	1.09E+01	-0.5%

6.5. FURTHER INFORMATION

Additional information is available on the Atlas Roofing Corporation website:

<https://www.atlasrwi.com/products/roof/polyiso-roof-insulation>.



7. REFERENCES

- [1] International Organization for Standardization (ISO), "ISO 14025 Environmental labels and declarations - Type III environmental declarations - Principles and procedures," 2006.
- [2] UL Solutions, *Part B : Roof Cover Protection Board EPD Requirements, UL 10010-36, First Edition*. 2021.
- [3] UL Environment, "Product Category Rule (PCR) Guidance for Building-Related Products and Services Part A: Life Cycle Assessment Calculation Rules and Report Requirements, UL 10010 (v.4.0)," 2022[Online]. Available: <https://www.ul.com/services/product-category-rules-pcrs#uledev>.
- [4] International Organization for Standardization (ISO), "ISO 14040:2006/AMD 1:2020 Environmental management - Life cycle assessment - Principles and framework," 2020.
- [5] International Organization for Standardization (ISO), "ISO 14044:2006/AMD1:2017/AMD 2:2020 Environmental management - Life cycle assessment - Requirements and guidelines," 2006.
- [6] International Organization for Standardization (ISO), "ISO 21930:2017(E) Sustainability in buildings and civil engineering works — Core rules for environmental product declarations of construction products and services," 2017.
- [7] United States Environmental Protection Agency (U.S. EPA), "Basic Ozone Layer Science," 2025. [Online]. Available: <https://www.epa.gov/ozone-layer-protection/basic-ozone-layer-science>. [Accessed: 17-Jul-2025].
- [8] United States Environmental Protection Agency (U.S. EPA), "Substitutes in Rigid Polyurethane and Polyisocyanurate Laminated Boardstock," 2025. [Online]. Available: <https://www.epa.gov/snap/substitutes-rigid-polyurethane-and-polyisocyanurate-laminated-boardstock#self>. [Accessed: 17-Jul-2025].
- [9] UL Solutions, "Part B: Building Envelope Thermal Insulation EPD Requirements, UL 10010–1, Edition 4," 2025[Online]. Available: <https://www.ul.com/resources/product-category-rules-pcrs>.
- [10] CEC, "Milestone Study on Plastics Waste Management in the US and Canada," Montreal, Canada, 2024[Online]. Available: https://www.cec.org/wp-content/uploads/Plastics_Full-Study.pdf.
- [11] NSF International, "NSF Certification Policies for Environmental Product Declarations (EPD)," 2022.
- [12] Vertima, "Atlas Roofing Corporation Life Cycle Assessment of Rigid Polyisocyanurate Foam Board Insulation," 2026.



2100 Riveredge Parkway, Suite 600

Atlanta, Georgia

30328 USA

www.atlasrwi.com

EPD

This LCA and EPD were prepared by Vertima Inc.

604 Saint Viateur Street
Quebec, QC
(418) 990-2800
G2L 2K8 CANADA



vertima

Environmental certification experts

vertima.ca